

## Operating Manual MU1001K

updated: 2023-03-14 / dr  
 from Firmware: 0-04



For more information and help about this product please scan the [QR-Code](#) or choose the following link: [MU1001K](#)

Operating manual, Quick guide, Datasheet, Connection diagram, CAD Data  
 Firmwareupdates, FAQ, Videos about installation and settings, Certificates

### - Universal-Measuring-Transducer



## Table of contents

1	General Notes .....	2
2	Application and short description.....	2
3	Overview of functions .....	3
4	Connecting diagram .....	3
5	Important Information .....	4
6	Installation .....	5
7	Commissioning.....	6
7.1	Overview of commissioning .....	6
7.2	Overview of the predefined standard ranges .....	6
7.3	Setting a predefined range.....	7
7.4	Diagram for setting a predefined range .....	8
7.5	Overview of scaling an arbitrary range .....	9
7.6	Scaling of range.....	9
7.7	Diagram for scaling of range .....	10
7.8	Factory setting.....	111
7.9	Query of firmware-version .....	11
7.9.1	Revision Firmware.....	111
8	Error search .....	111
9	Technical data .....	111
10	Housing Type K.....	133
11	Disposal .....	13

## 1 General Notes

Compliance with the following instructions is mandatory to ensure the functionality and safety of the product. If the following instructions given especially but not limited for general safety, transport, storage, mounting, operating conditions, commissioning and disposal / recycling are not observed, the product may not operate safely and may cause a hazard to the life and limb of users and third parties.

Deviations from the following requirements may therefore lead both to the loss of the statutory material defect liability rights and to the liability of the buyer for the product that has become unsafe due to the deviation from the specifications.

## 2 Application and short description

Universal Measuring-Transducers MU1001K can measure DC-signals up to 300 V.

Pre-set measuring-ranges can be selected by the user.

More measuring-ranges (zero and full scale) can be easily scaled.


The output-signals DC 0/2-10 V and 0/4-20 mA are insulated from measuring-input and supply-voltage.

With its universal power-supply AC/DC 24-240 V the measuring-transducer can be connected to all common supply-voltages.

### 3 Overview of functions

- Current input 0-20mA, scalable
- Voltage input 0-10V, scalable
- Input Pt 100, 3-wire, -200...+800 °C, scalable
- Output signal 0-20mA and 0-10V or 4-20mA and 2-10V
- Rated Supply Voltage AC/DC 24-240V
- Insulation between inputs, outputs and supply voltage
- Standard ranges adjustable, universally scalable input ranges

### 4 Connecting diagram

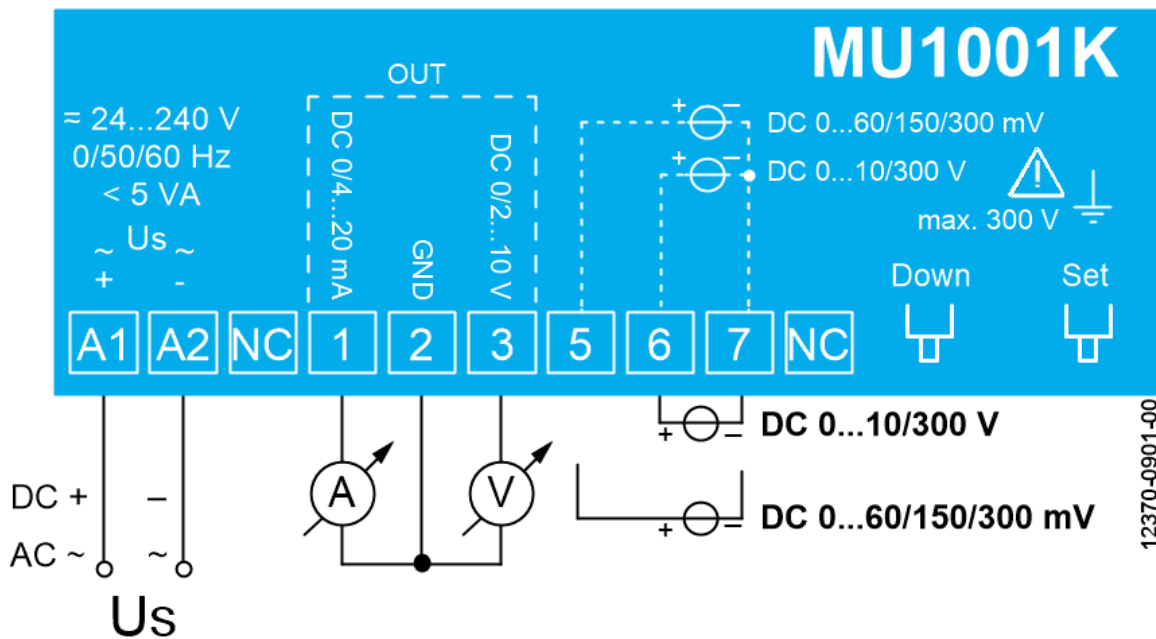

## 5 Important Information



### **DANGER!**

**Hazardous voltage!**

**Will cause death or serious injury. Turn off and lock out all power supplying this device before working on this device.**



### **Attention!**

**The measuring input fulfils reinforced insulation according to DIN EN 61010-1 for overvoltage category II, measuring category II and pollution degree 2. Connected voltages may not exceed 300 V AC/DC to earth.**

To use the equipment flawless and safe, transport and store properly, install and start professionally and operate as directed.

Only let persons work with the equipment who are familiar with installation, start and use and who have appropriate qualification corresponding to their function. They must observe the contents of the instructions manual, the information which are written on the equipment and the relevant security instructions for the setting up and the use of electrical units.

The equipment is built according to DIN VDE/EN/IEC and checked and leave the plant according to security in perfect condition. If, in any case the information in the instructions manual is not sufficient, please contact our company or the responsible representative.

In order to maintain this status, you must observe the safety regulations entitled "caution" in this operating manual. Failures to follow the safety regulations can result in death, personal injury or property damage to the device itself and to other devices and facilities.

To maintain this condition, you must observe the safety instructions in this instruction manual titled "Important Information". Failure to follow the safety instructions may result in death, personal injury, or property damage to the equipment itself and other equipment and facilities.

Instead of the industrial norms and regulations written in this instruction manual valid for Europe, you must observe out of their geographical scope the valid and relevant regulations of the corresponding country.



### **Attention!**

**Only one of the two measuring inputs terminals 5+7 or terminals 6+7 may be used.**

## 6 Installation

The unit can be installed as follows:

- Installation in switchgear cabinet on 35 mm mounting rail according to EN 60715 for protection against fire, external environmental conditions and mechanical effects.
- With screws M4 for installation on walls or panel. (additional latch is not included in delivery)
- Connection according to connection plan or type plate.

Failure to comply with the information in this instruction manual will not guarantee the function of the device.



**Attention!**

**A circuit-breaker or switch must be situated within easy reach of the unit and fused. Installation excess current protection should be  $\leq 10$  A.**



**Attention! Universal power supply**

**The device has a universal power supply, that is suitable for DC- and AC-voltages. Before connecting the device to supply-voltage make sure that the connected voltage corresponds with the voltage on the lateral type on the device**



**Attention!**

**Observe the maximum temperature permissible when installing in switching cabinet. Make sure sufficient space to other equipment or heat sources. If the cooling becomes more difficult e.g. through close proximity of apparatus with elevated surface temperature or hindrance of the cooling air, the tolerable environmental temperature is diminishing.**



**Attention!**

**All wires connected to the device must have insulation rated at least 300 Vac.**

## 7 Commissioning

### 7.1 Overview of commissioning

The MU1001K can be commissioned to predefined standard ranges or scaled to an arbitrary range. There are two different ways to do the settings:

Point 6.2 – 6.4: MU1001K setting a predefined range

Point 6.5 – 6.7: MU1001K scaling an arbitrary range

### 7.2 Overview of the predefined standard ranges

Following standard ranges can be set without adjustment to the unit:

Input (300 V)	
Zero point	Full scale
0 V ...	20 V
0 V ...	50 V
0 V ...	100 V
0 V ...	200 V
0 V ...	300 V

Input (10 V)	
Zero point	Full scale
0 V ...	10 V
2 V ...	10 V
-10 V ...	10 V

Output (mV)	
Zero point	Full scale
0 mV ...	60 mV
0 mV ...	150 mV
0 mV ...	300 mV
-60 mV ...	60 mV
-150 mV ...	150 mV
-300 mV ...	300 mV


### 7.3 Setting a predefined range

Power off the device				
Press Button <b>[Set]</b> and keep pressed				
Power on the device, and keep pressed the button <b>[Set]</b>				
After 5s flashes the green LED, release button <b>[Set]</b>				
Parameterization „input type“ >> LED ON flashes 1x				
Select with button <b>[Set]</b> the input type (displayed by LEDs 300 V / 10 V / mV)				
Press button <b>[Down]</b>				
Parameterization „range“ >> LED ON flashes 2x				
<ul style="list-style-type: none"> <li>Select with button <b>[Set]</b> the range of the input</li> </ul>	Number of flashes	<b>300 V</b>	<b>LED</b> <b>10 V</b>	<b>mV</b>
	1 x	0 - 20 V	0 - 10 V	0 - 60 mV
	2 x	0 - 50 V	2 - 10 V	0 - 150 mV
	3 x	0 - 100 V	-10...10 V	0 ... 300 mV
	4 x	0 - 200 V		-60...60 mV
	5 x	0 - 300 V		-150...150 mV
Press button <b>[Down]</b>				
Parameterization „output“ >> LED Power flashes 4x				
<ul style="list-style-type: none"> <li>Select with button <b>[Set]</b> the output range</li> </ul>	Number of flashes	<b>LED</b> <b>10 V + mV</b>		
	1 x	0 - 10V / 0 - 20mA		
	2 x	2 - 10V / 4 - 20mA		
Press button <b>[Down]</b>				
End of parameterization, LED ON lights permanently				

#### **Attention:**

- When no button is pressed during scaling for 120 s, the process is cancelled automatically. Entered values will be discarded.
- When scaling is started, all parameters are reset to default. Parameters cannot be checked after scaling has been finished.
- In normal operating mode the selected input is displayed with LED.

## 7.4 Diagram for setting a predefined range

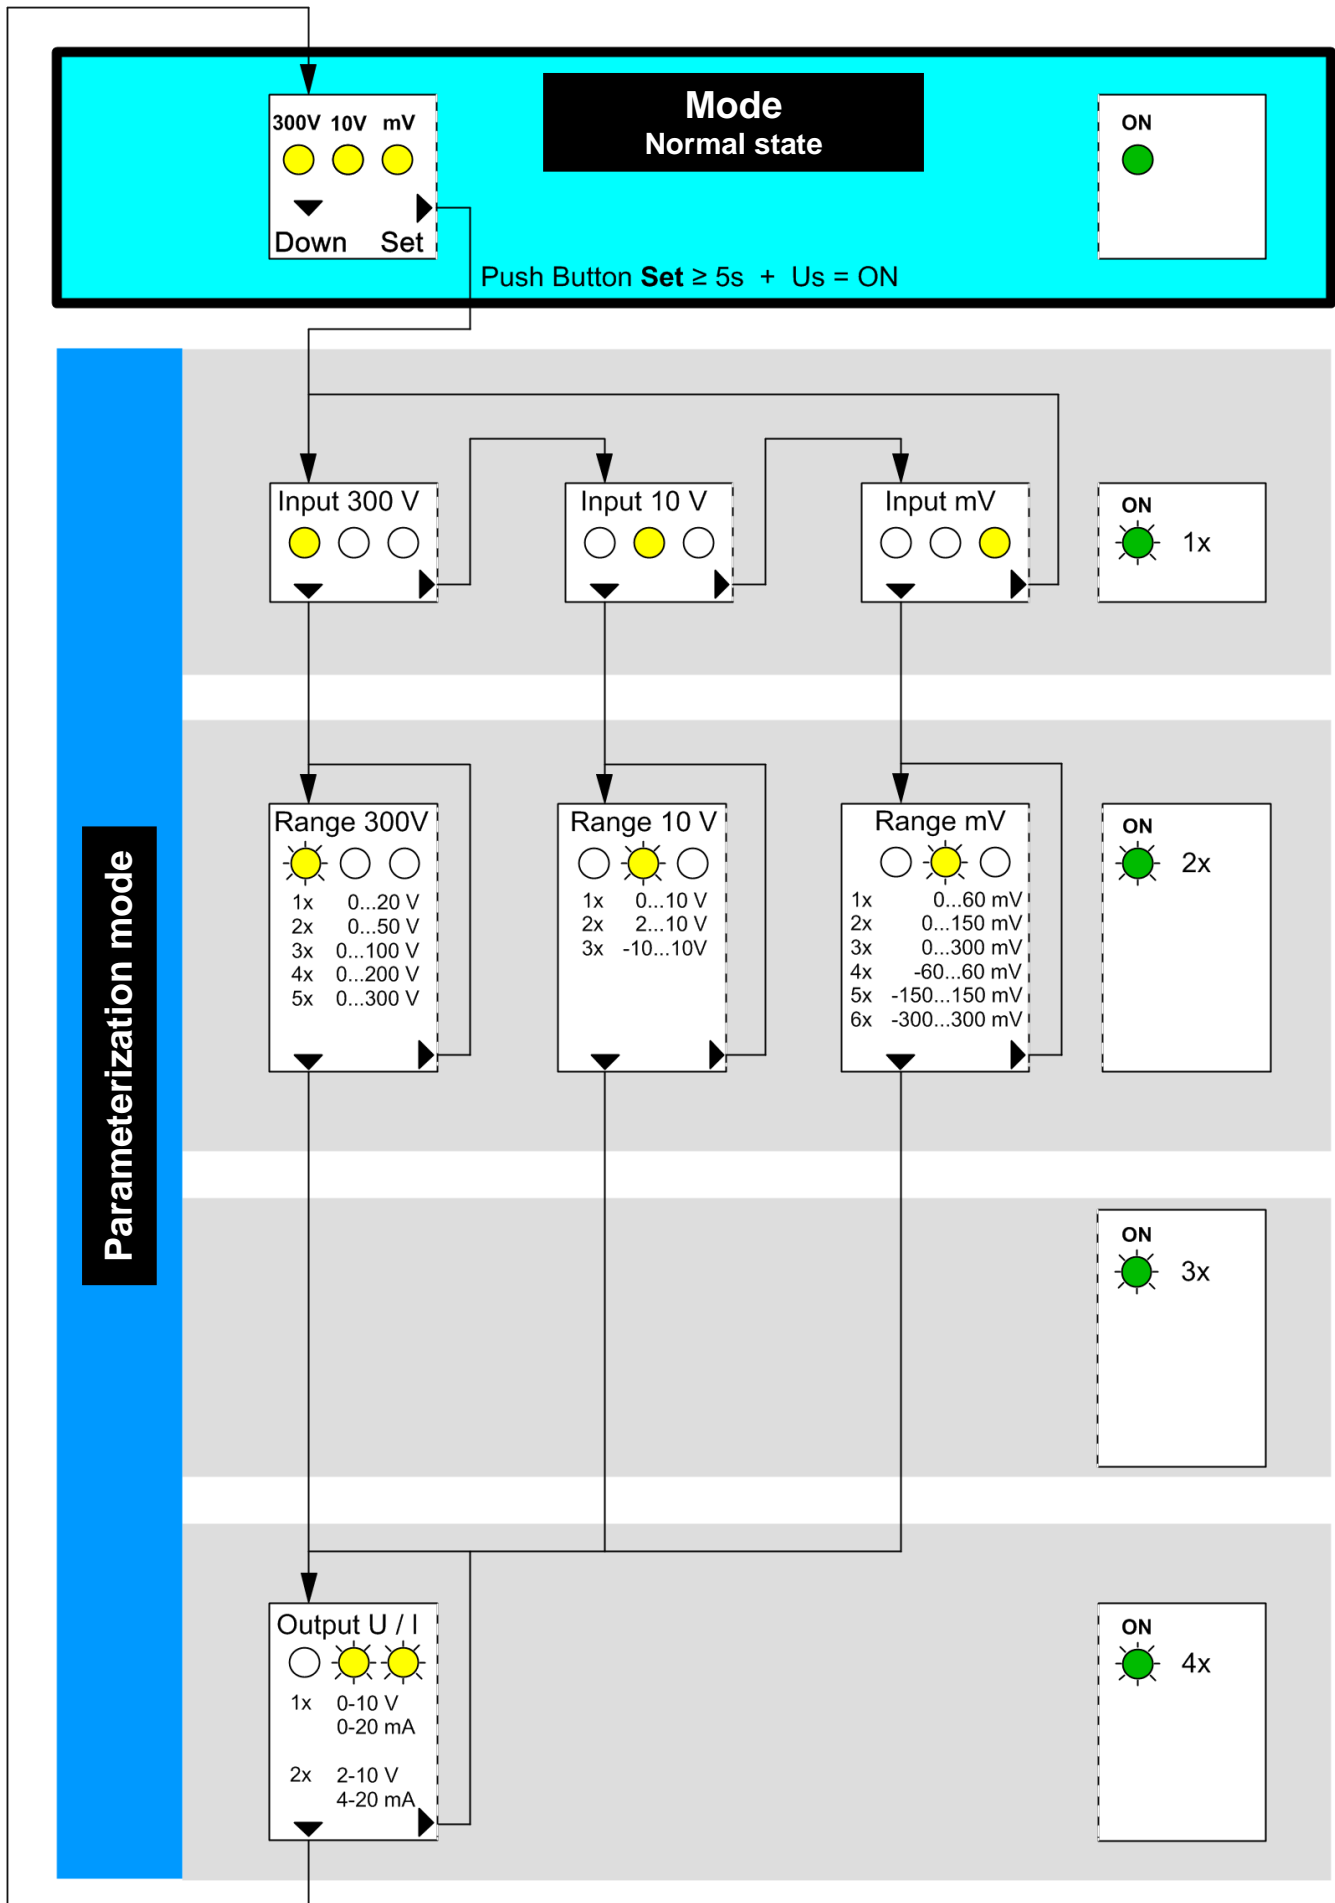



## 7.5 Overview of scaling an arbitrary range

Other ranges may be set by scaling of the input signal:

Input	range		Output
	Zero point	Full scale	
300 V	0 ... 300 V	0 ... 300 V	0 - 10 V / 0 - 20 mA oder 2 - 10 V / 4 - 20 mA
10 V	-10 ... 10 V	-10 ... 10 V	
mV (300 mV)	-300 ... 300 mV	-300 ... 300 mV	

## 7.6 Scaling of range


Parameterization:

Power off the device		
Press Button <b>[Down]</b> and keep pressed		
Power on the device, and keep pressed the button [Down]		
After 5s flashes the green LED, release button [Down]		
Parameterization „input type“ >> LED Power flashes 1x		
Select with button [Set] the input type (displayed by LEDs 300 V / 10 V / mV)		
Press button [Down]		
Parameterization „input zero point“ >> LED Power flashes 2x		
Connect a signal at the input corresponding to the zero point		
Press button [Down] (store of value, green LED flashes 3 times quickly)		
Parameterization „input full scale“ >> LED Power flashes 3x		
Connect a signal at the input corresponding to the full scale		
Press button [Down] (store of value, green LED flashes 3 times quickly)		
Parameterization „output“ >> LED Power flashes 4x		
• Select with button [Set] the output range	Number of flashes	LED 10 V / mV
	1 x	0 - 10V / 0 - 20mA
	2 x	2 - 10V / 4 - 20mA
Press button [Down]		
End of parameterization, Power LED lights permanently		

### Attention:

- When no button is pressed during scaling for 120 s, the process is cancelled automatically. Entered values will be discarded.
- When scaling is started, all parameters are reset to default. Parameters cannot be checked after scaling has been finished.
- In normal operating mode the selected input is displayed with LED.

## 7.7 Diagram for scaling of range

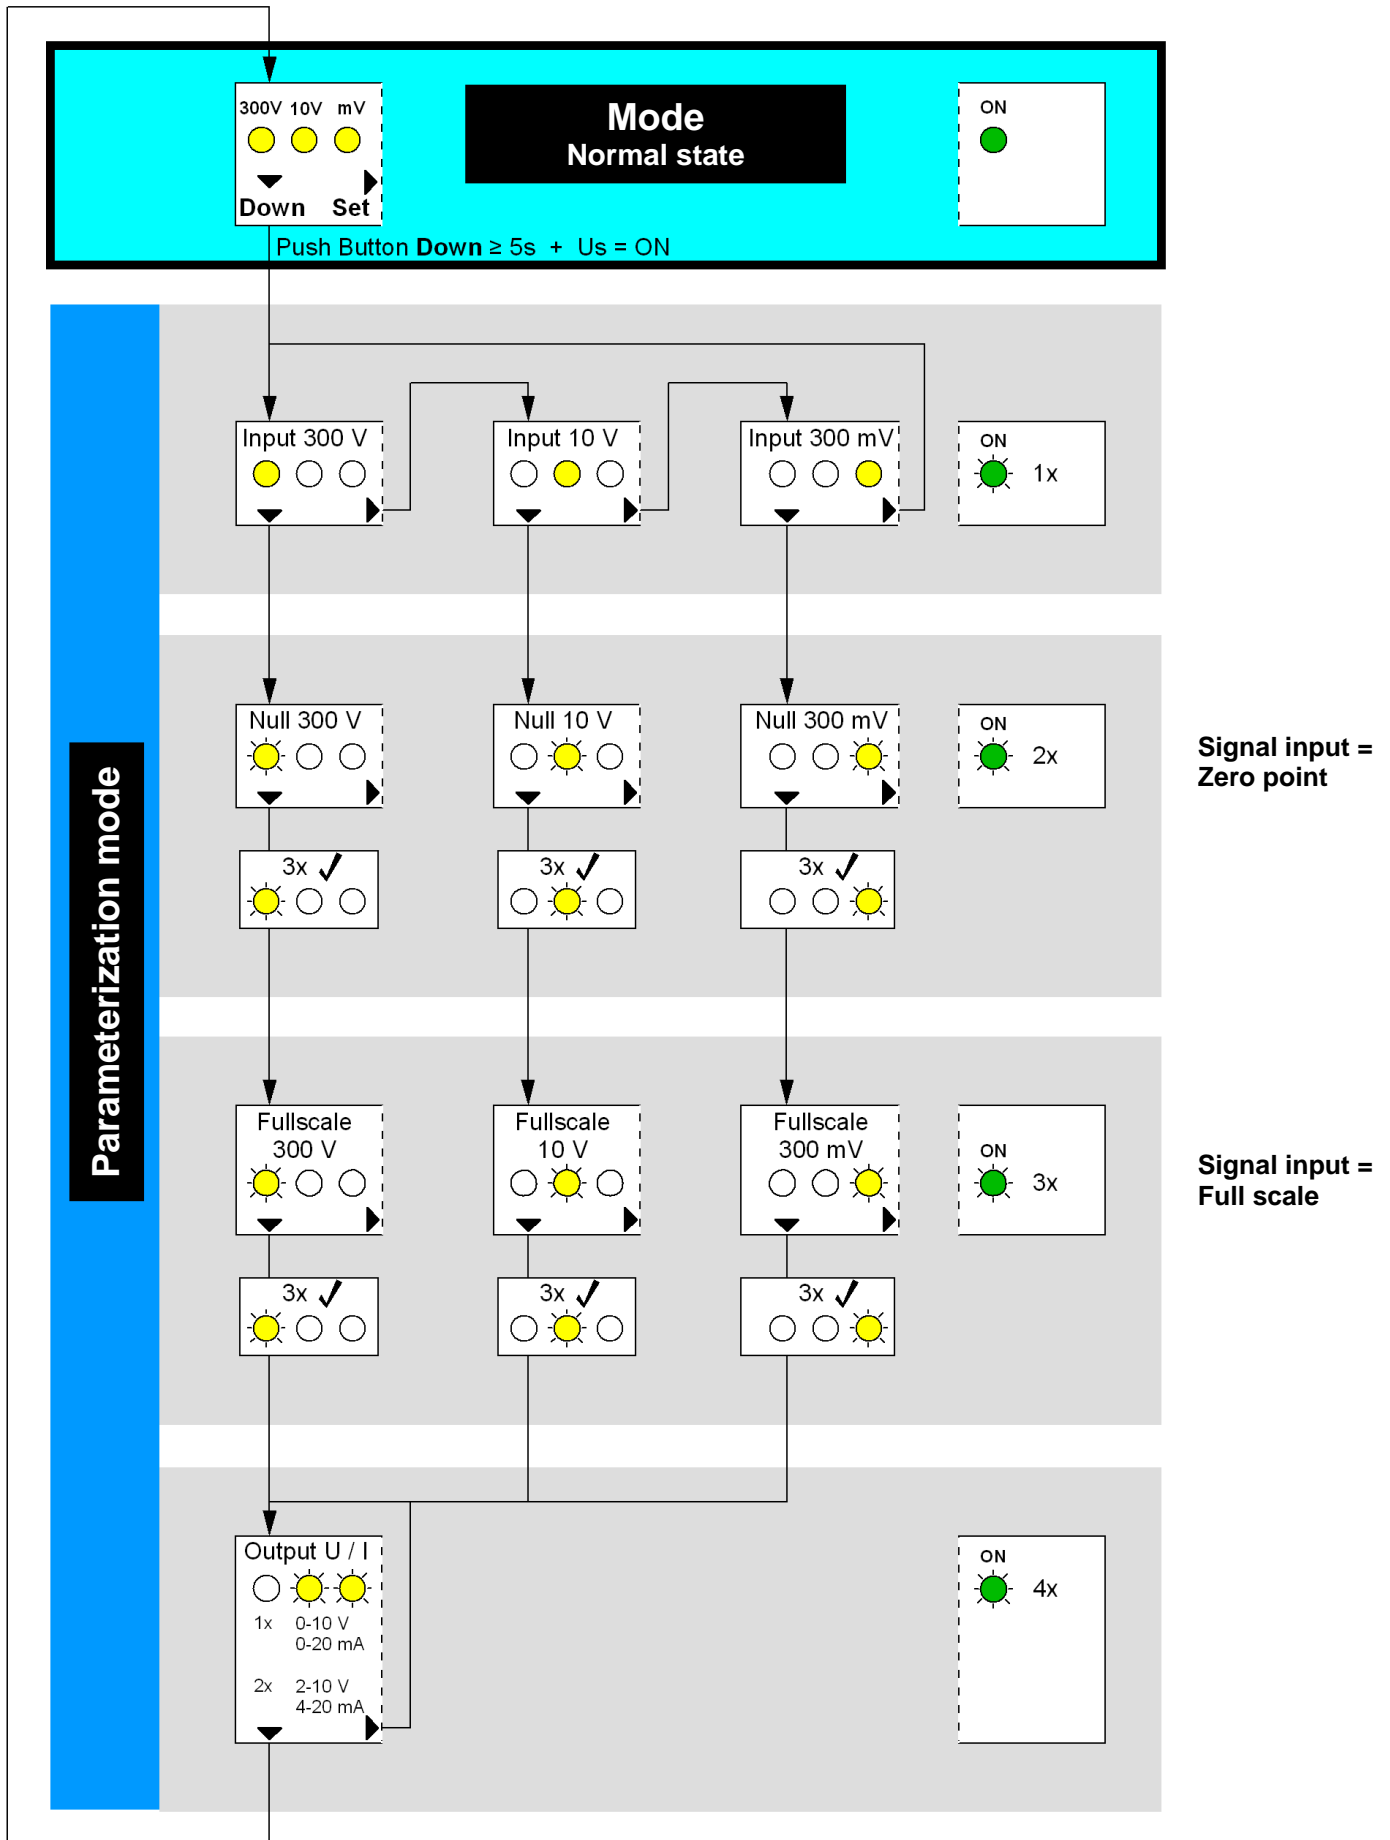

## 7.8 Factory setting

Default settings:

Input: [10 V] -> DC 0 – 10 V

Output: 0 – 10V, 0 – 20 mA

## 7.9 Query of firmware-version

from firmware 0-04:

- Keep [Set] button pressed ( $\geq 5s$ )  
 => LEDs indicate the firmware version by fast blinking  
 (binary coded, LED 300V = bit0 ... LED ON = bit3)

LED	300 V	10 V	mV	ON
Bit No. (value)	0 (1)	1 (2)	2 (4)	3 (8)
example (LED)	off	off	flash	off

➔ Version 0-04

### 7.9.1 Revision Firmware

Version 0-04:

- additional predefined standard ranges (-10...10V, -60...60mV, -150...150mV, -300...300mV)

## 8 Error search


Wrong output signal (current/voltage) OUT (terminal 1 – 2 – 3)	
<b>Cause</b>	The device is not configured correctly
<b>Remedy</b>	Check commissioning

For selected output range 4-20 mA (2-10V) the current is < 3,8 mA (the voltage is <1,9V)	
<b>Cause</b>	Sensor short-circuit or sensor interruption
<b>Remedy</b>	Check sensor/wire at terminal 5-6-7

## 9 Technical data

Rated supply voltage $U_s$	AC/DC 24 – 240 V	0/50/60Hz
Tolerance	DC 20,4 - 297 V	AC 20 - 264 V
Power consumption	< 3 W	< 8 VA

Input	Input-resistance	Maximum Input signal	Error of full scale
DC 300 V	500 k $\Omega$	DC $\pm$ 300 V	0,1 %
DC 10 V	500 k $\Omega$	DC $\pm$ 300 V	0,1 %
DC 60mV	10 M $\Omega$	DC $\pm$ 2 V	0,1 %
DC 150mV	10 M $\Omega$	DC $\pm$ 2 V	0,1 %
DC 300mV	10 M $\Omega$	DC $\pm$ 2 V	0,1 %
Resolution	14 Bit		
Measuring time	< 20 ms		

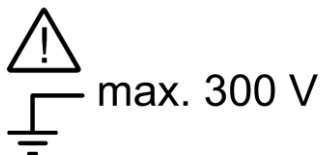


<b>Output</b>	2 outputs with common ground	
Response-time T09	< 40 ms	
Voltage output	DC 0/2 – 10 V	
Tolerance	0,3 % of full scale (from 0,1 V)	
Temperature factor	< 0,01 % / K	
Resolution	11,6 Bit	< 3,1 mV
Load	≥ 1 k Ω	
Current output	DC 0/4 – 20 mA	
Tolerance	0,3 % of full scale (from 0,1 mA)	
Temperature factor	< 0,015 % / K	
Resolution	11,6 Bit	< 6,1 μA
Load	≤ 500 Ω	
Error from load	(250 Ω – resistance) / 250 Ω * 0,3 % of final value	
<b>Galvanic insulation</b>	Us – input - output	
Test voltage	Us – output	DC 3540V
	Us – input	DC 3540V
	Input – output	DC 3540V
<b>Test conditions</b>	EN 61010-1	
Rated supply voltage Us (terminals A1,A2)		
Pollution degree	2	
Overvoltage category	III reinforced insulation	
Rated insulation voltage Ui	300 V	
Input (terminals 5,6,7)		
Pollution degree	2	
Overvoltage category	II reinforced insulation	
Rated insulation voltage Ui	300 V	
<b>EMC-tests</b>	EN 61326-1	
	Equipment intended for use in industrial locations	
Emission	EN 61326-1, CISPR 11 class B	
Immunity	EN 61326-1 industrial environment	
Electrical fast transient (Burst)	EN 61000-4-4 ±4,5 kV	
	Pulse 5/50 ns, f = 5 kHz, t = 15 ms, T = 300 ms	
Surge immunity test	IEC 61000-4-5 ±2 kV	
<b>Environmental conditions</b>		
Permissible ambient temperature	-20 °C ... +65 °C	
Permissible storage temperature	-20 °C ... +70 °C	
Permissible wiring temperature	-5 °C ... +70 °C	
Climatic conditions	5 – 85 % rel. humidity, no condensation	
Installation height	< 2000 m	
Vibration resistance EN 60068-2-6	2...25 Hz ±1,6 mm	
	25 ... 150 Hz 5 g	

Housing	Type K
Dimension (H x W x D)	75 x 22,5 x 115 mm
Width	1 TE
Line connection solid wire	each 1 x 0,5...2,5 mm <sup>2</sup>
Stranded wire with insulated ferrules	each 1 x 0,14...1,5 mm <sup>2</sup>
Torque	0.5 Nm (3,6 lb.in)
Protection class housing / terminals	IP 40 / IP 20
Mounting	Snap mounting on 35 mm standard rail EN 60 715 or M4 screws
Weight	app. 100 g

Subject to technical changes

### 10 Housing Type K

Dimensions in mm

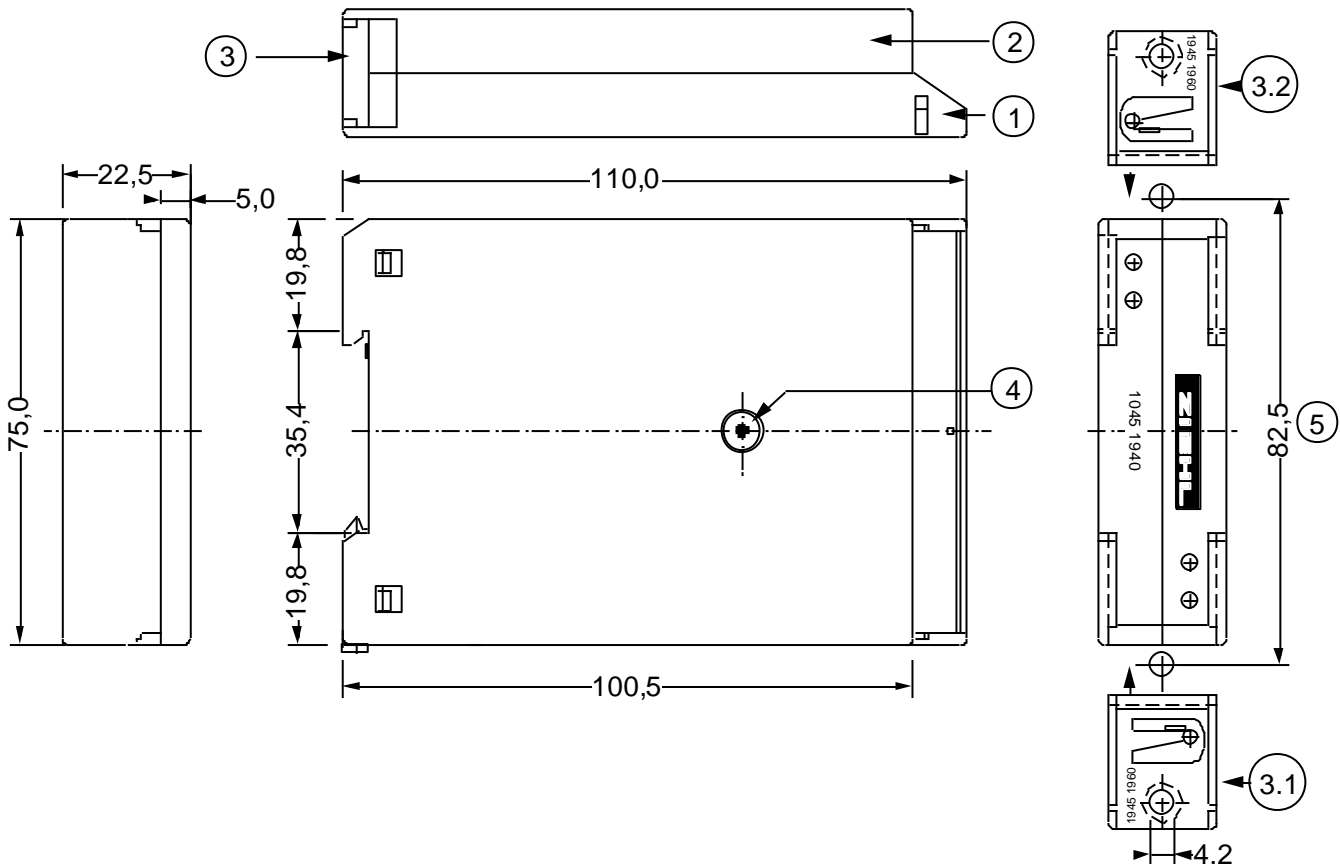

- 1 lower part
- 2 upper part
- 3 bar
- 4 screw
- 5 holes for screw-mount

### 11 Disposal



Disposal should be carried out properly and in an environmentally friendly manner in accordance with legal provisions. ZIEHL is registered with the EAR Foundation under WEEE no.: DE 49 698 543.